



4x $\varnothing 11$

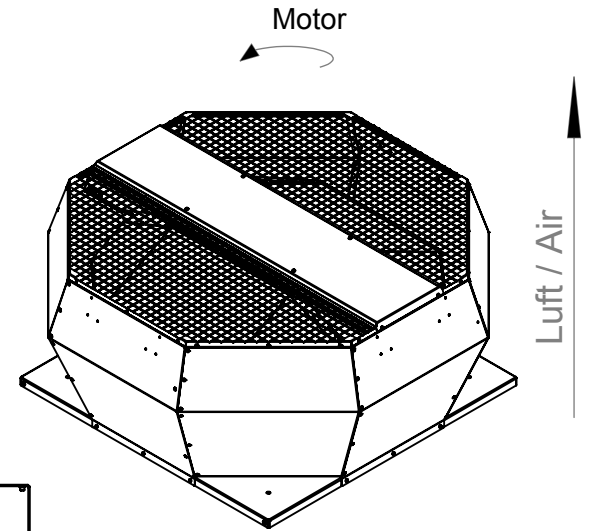

$\varnothing 605$
M8x15 (8x)

cable outlet

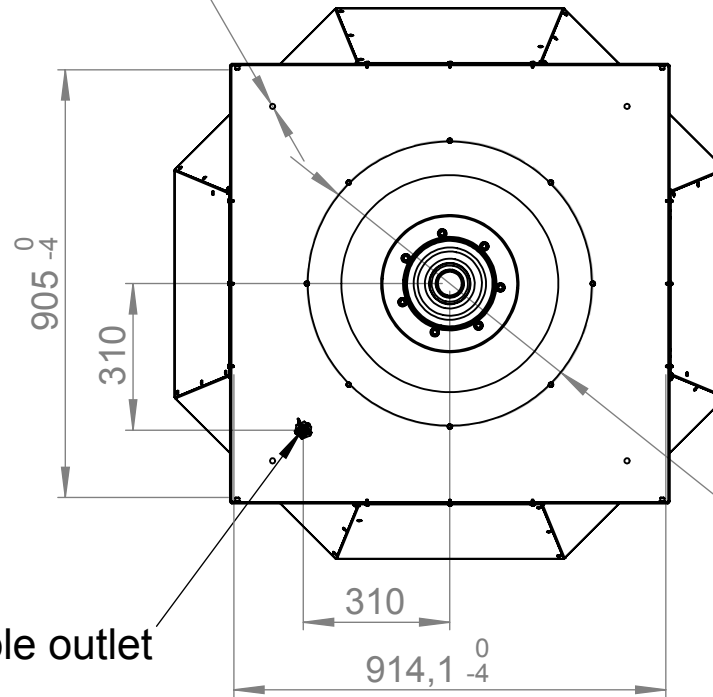

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO16016

Drawn: l.benk
Created: l.benk
Changed: l.benk

1:15 A4 mm

General tolerances
DIN ISO 2768-mK

DVA630ECC30

133008 00

11.06.15
11.06.15
08.07.15